

**Raccordement**

**Alimentation:**

**+Vs** Alimentation +12Vcc  
**GND** Alimentation 0Vcc

**1 Entrée bus RS485:**


**DATA +** RS485 A  
**DATA -** RS485 B

**3 Sorties bus RS485:**

**DATA1 +** RS485 A – Voie 1  
**DATA1 -** RS485 B – Voie 1

**DATA2 +** RS485 A – Voie 2  
**DATA2 -** RS485 B – Voie 2

**DATA3 +** RS485 A – Voie 3  
**DATA3 -** RS485 B – Voie 3

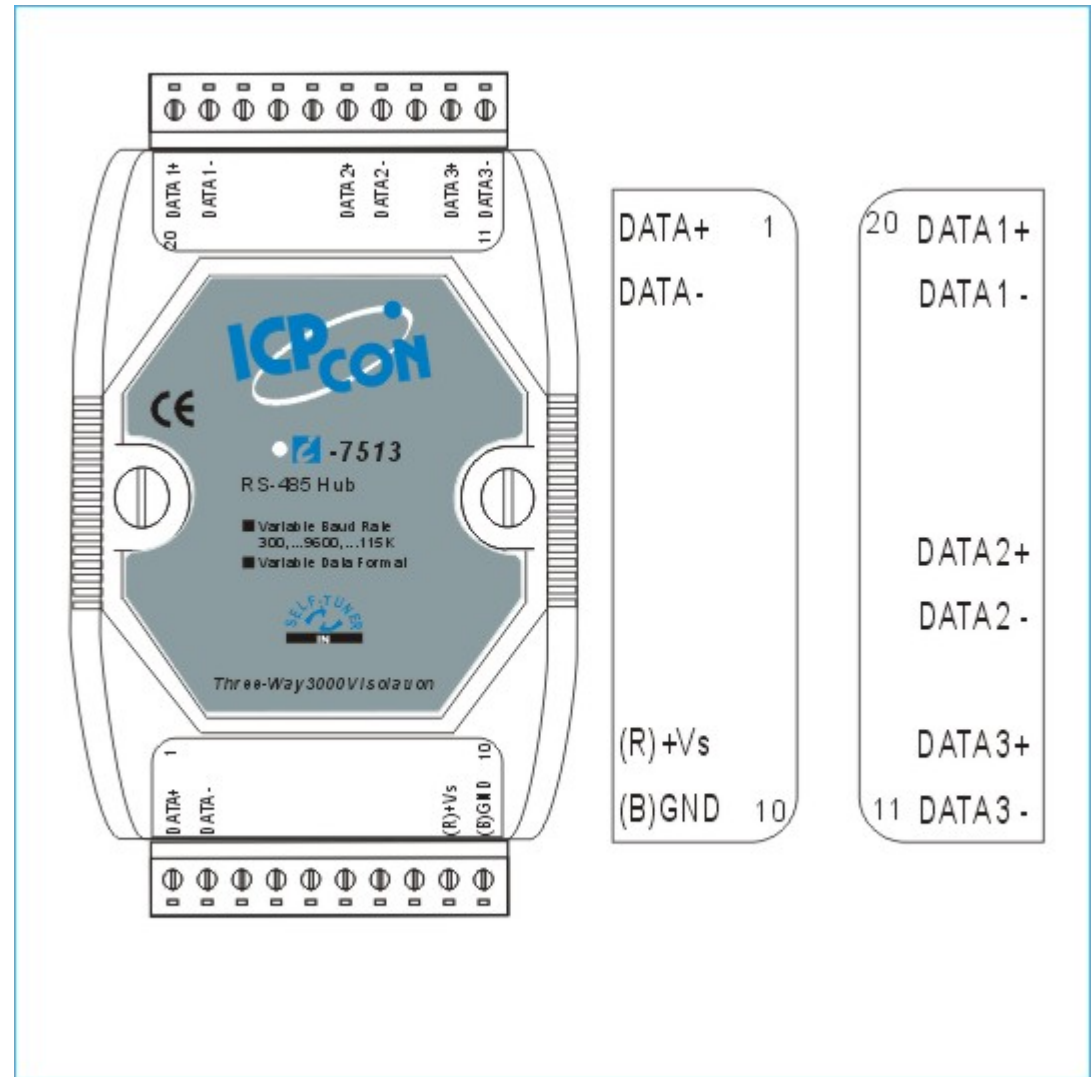

**HUB 485 3 VOIES IX-HR7513**

V1.0

**IXOFF**

31/01/2007

**APPROUVE**